




NFPA 170 REQUIREMENT

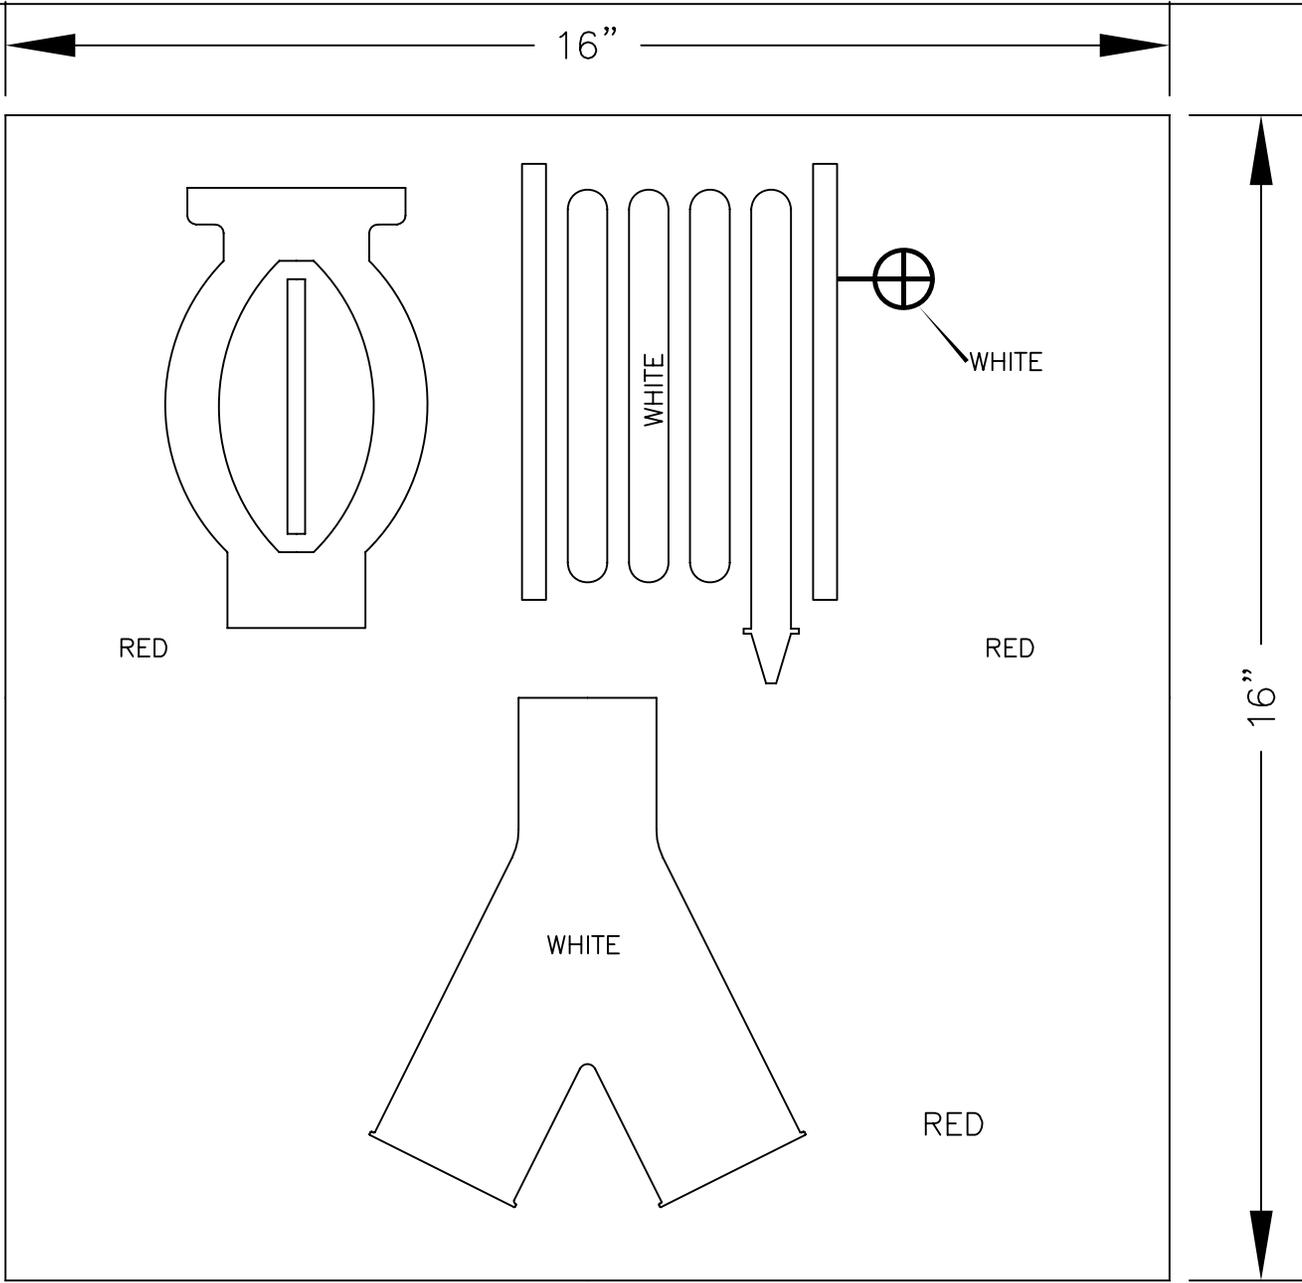


SIGN MUST BE 16" X 16" RED REFLECTIVE BACK GROUND.  
OBJECTS MUST BE IN WHITE. (SPRINKLER HEAD AND OTHER CONNECTIONS).  
MOUNTED ABOVE THE CONNECTION SO THEY ARE MORE VISIBLE TO RESPONDING EQUIPMENT.  
\*NOTE BOTTOM OF SIGN TO BE 10' FROM GRADE

**COMBINATION**




NFPA 170 REQUIREMENT

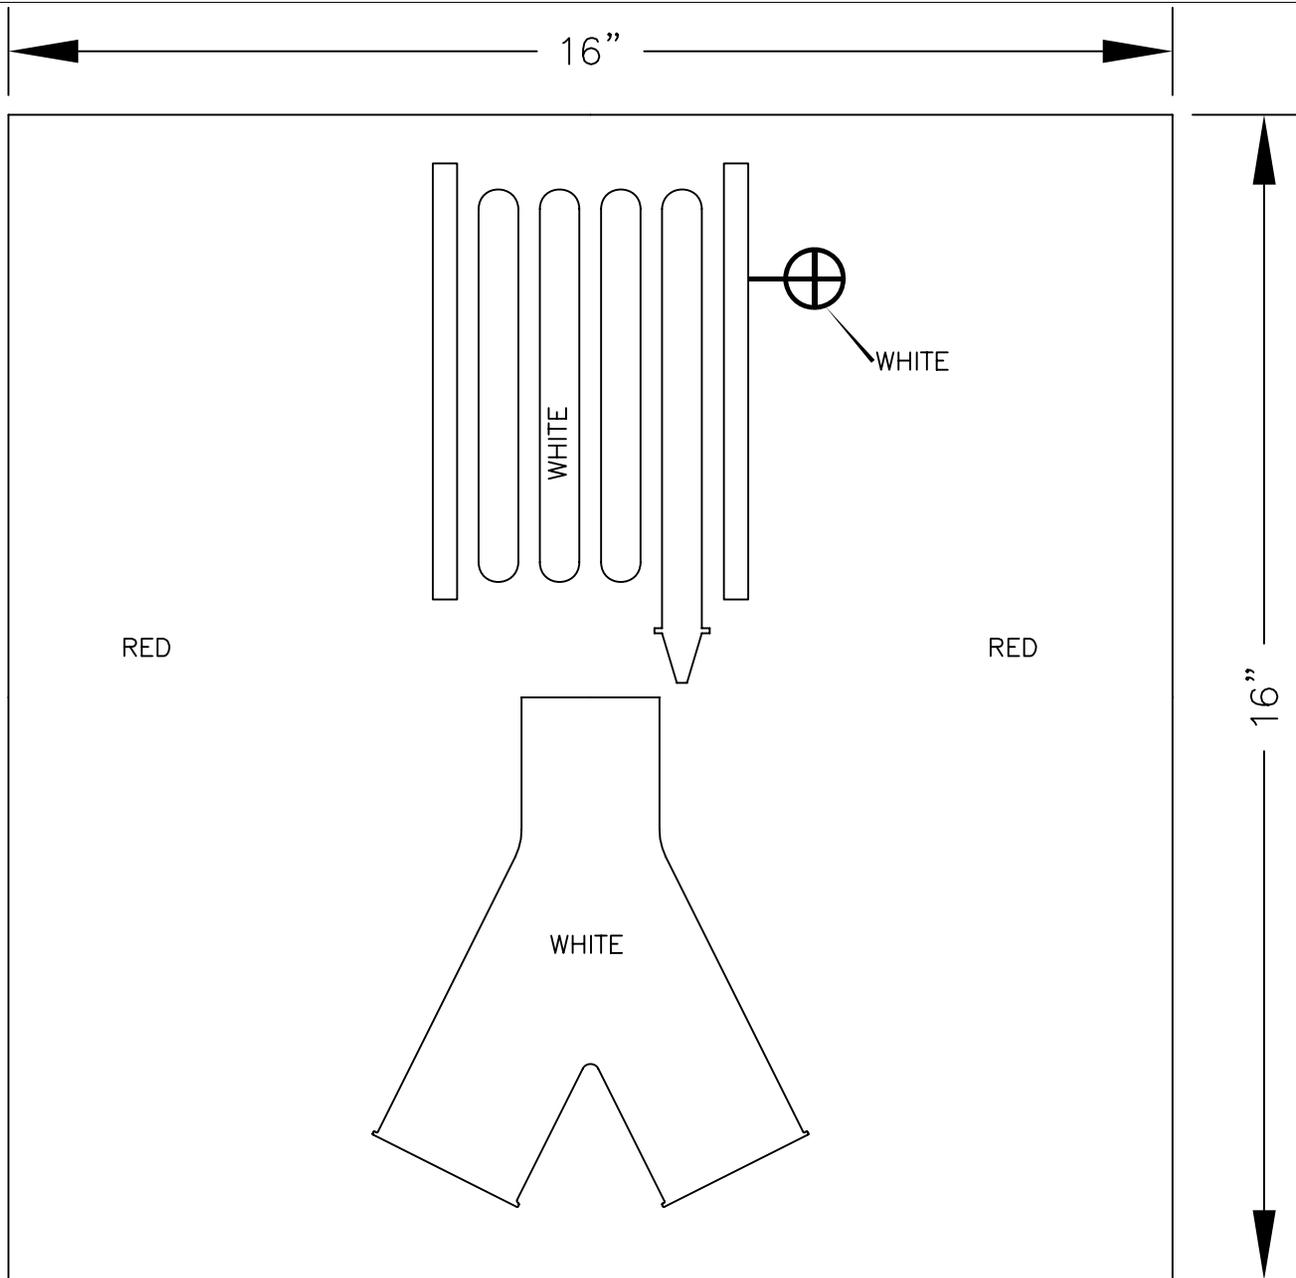


SIGN MUST BE 16" X 16" RED REFLECTIVE BACK GROUND.  
OBJECTS MUST BE IN WHITE. (SPRINKLER HEAD AND OTHER CONNECTIONS).  
MOUNTED ABOVE THE CONNECTION SO THEY ARE MORE VISIBLE TO RESPONDING EQUIPMENT.

\*NOTE BOTTOM OF SIGN TO BE 10' FROM GRADE

### STANDPIPE

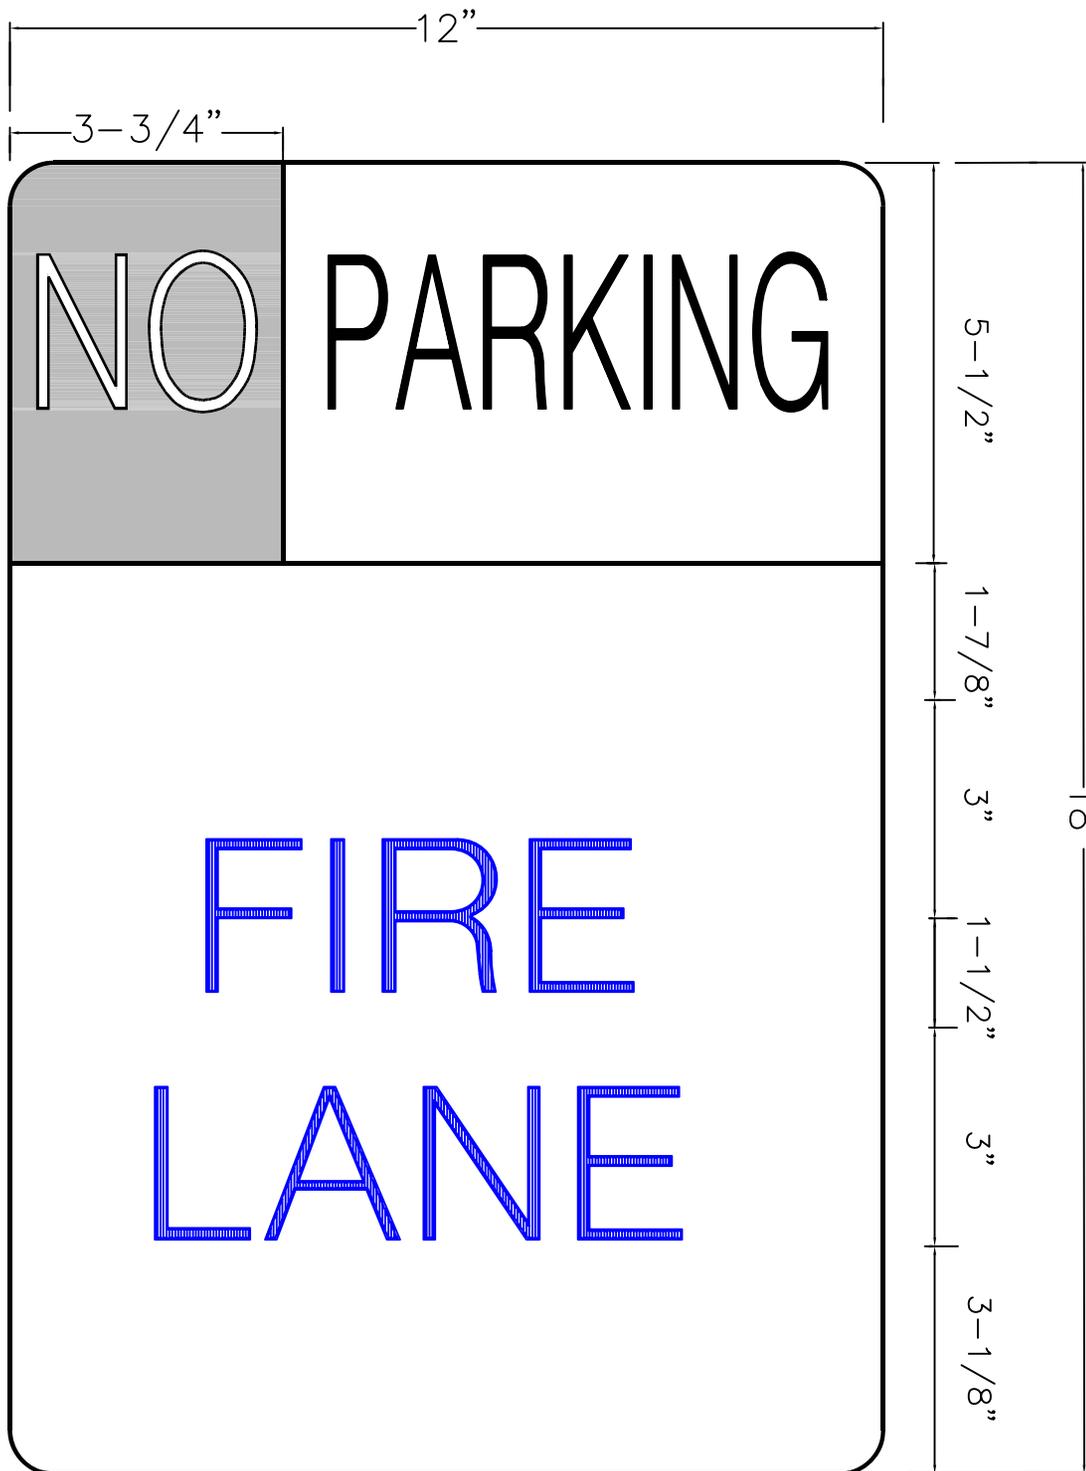

- NOTES:
1. The sign shall have a white scotchlite background with red scotchlite letters except for the word "no" which shall have the color scheme reversed.
  2. All lettering shall be 3 inches in height except for the word "parking" which shall be 2 inches in height.

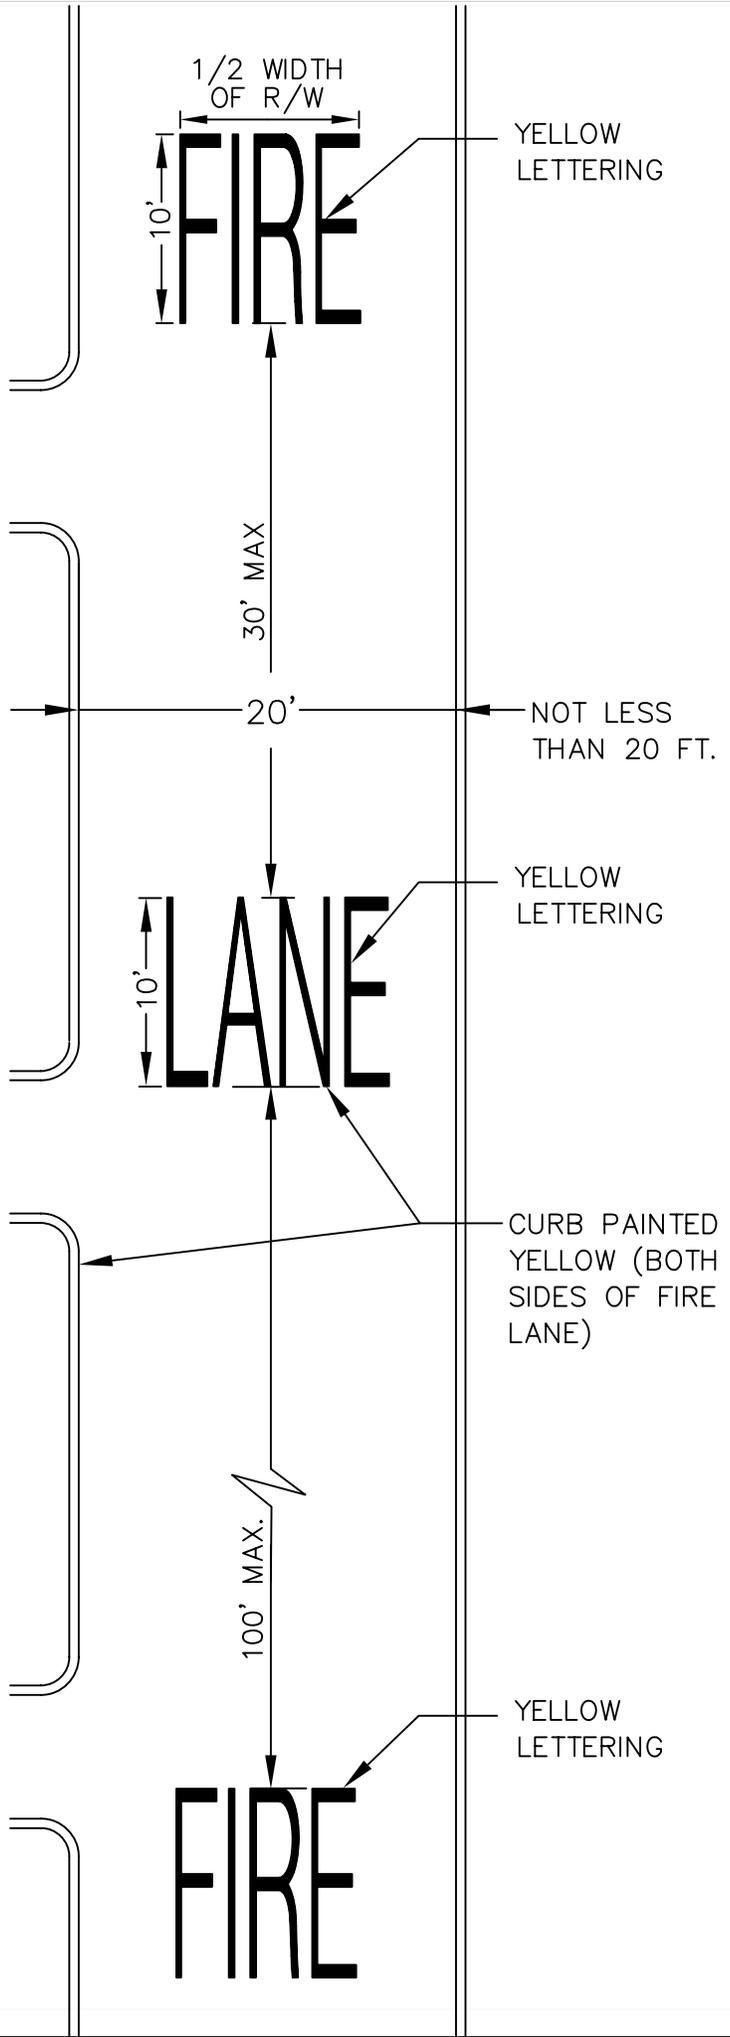

# FIRE LANE DETAIL

SCALE: 1"=10'